



ENERG

енергия · ενεργεια



10361402


NOVELAN

SIP 37.1



55 °C

35 °C

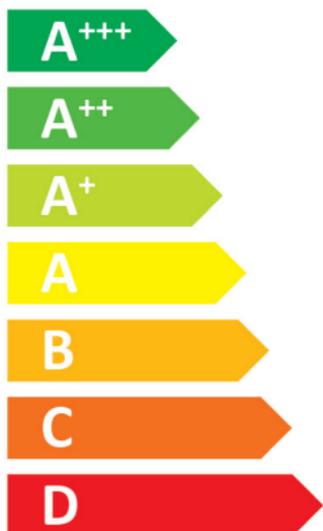

54 dB



- dB

■ 35
■ **35**
■ 35
kW

■ 37
■ **37**
■ 37
kW





ENERGY

10361402


NOVELAN

SIP 37.1



55 °C

35 °C

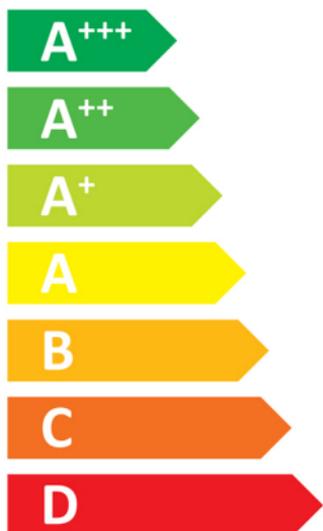

A⁺⁺

A⁺⁺⁺



54 dB



- dB

■ 35
■ **35**
■ 35
kW

■ 37
■ **37**
■ 37
kW





ENERG

енергия · ενεργεια

Y

IJA


IE

IA

10361402

NOVELAN

SIP 37.1 + WPR-Net 2.05



A⁺⁺

A⁺⁺⁺

A⁺⁺

A⁺⁺

A⁺

A

B

C


D

E

F

G

+



+



+



+



package (heat pumps and combination heater with heat pump) - SIP 37.1 + WPR-Net 2.05

Seasonal space heating energy efficiency of heat pump (η_s) ① 137 %

Rated heat output of the heat pump (P_{rated} kW) 35

Temperature control Class VII (Table 1) + ② 3,5 %

Supplementary boiler
package with hot water storage tank no P_{sup} kW (rated heat output of supplementary heater)

η_s % ($\sigma\pi$) $(\eta_s \% (sup) - ①) \times (\alpha_{WP}) =$ - ③

(α_{WE} : see Table 3) (α_{WE})


solar contribution $(A_{Koll} m^2)$ $(\eta_{Koll} \%)$
 $(V_{Sp} m^3)$ $(standstill\ heat\ loss\ of\ the\ hot\ water\ storage\ tank\ in\ W)$
 $(\eta_{Sp}: Table\ 2)$

$((294/P_{rated} \times 11) \times (A_{Koll} m^2) + (115/P_{rated} \times 11) \times (V_{Sp} m^3)) \times 0,45 \times ((\eta_{Koll} \%) / 100) \times (\eta_{Sp}) =$ + ④

Seasonal space heating energy efficiency of package ⑤ 141 %

rounded to the nearest integer

Seasonal space heating energy efficiency class of package

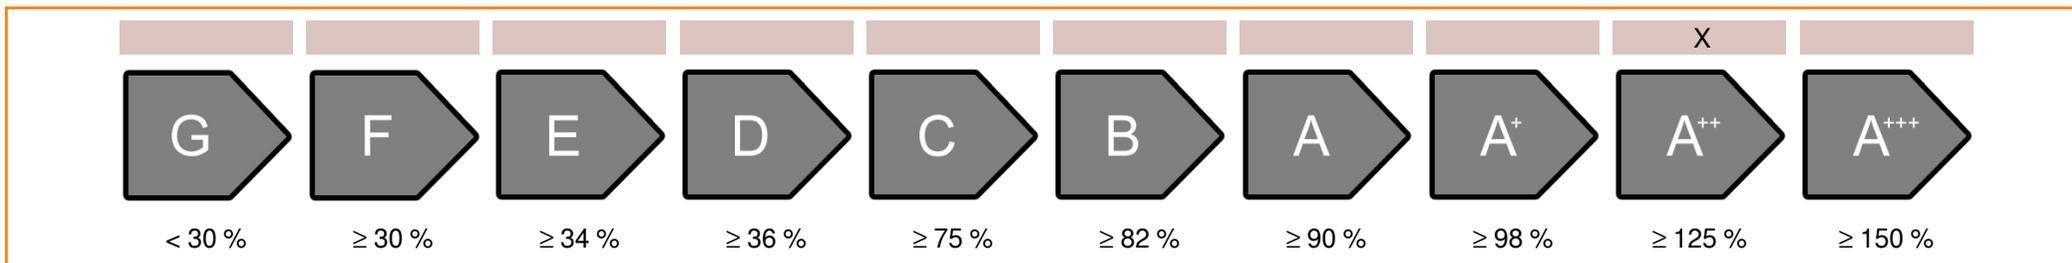

Seasonal space heating energy efficiency under colder or warmer climate conditions

Seasonal space heating energy efficiency of the heat pump (η_s) under colder climate conditions 141 %

Seasonal space heating energy efficiency of the heat pump (η_s) under warmer climate conditions 138 %

colder ⑤ 141 -V -4 = 145 warmer ⑤ 141 +VI 1 = 142

heatpump datasheet:			
manufacturer:	NOVELAN		
model:	SIP 37.1		
Information concerning energy efficiency class and rated heat output:			
	average / low	average / medium	
energy efficiency class space heater:	A+++	A++	-
rated heat output:	37	35	kW
energy efficiency space heater:	201	137	%
annual final energy consumption space heater	14673	19832	kWh
sound power level indoors		54	dB
special precautions concerning assembly, installation or maintenance			
All instructional work in this manual may only be carried out by qualified specialist personnel in compliance with local regulations.			
additional information	low	medium	
rated heat output colder climate	37	35	kW
rated heat output warmer climate	37	35	kW
energy efficiency space heater colder climate	207	141	%
energy efficiency space heater warmer climate	204	138	%
annual energy consumption space heater colder climate	17024	23100	kWh
annual energy consumption space heater warmer climate	9390	12741	kWh
sound power level outdoors		-	dB

technical data of the temperature controller		
manufacturer:	NOVELAN	
model:	WPR-Net 2.05	
controller class	VII	-
contribution of the controller to the energy efficiency space heater	3,5	%

Model				SIP 37.1			
Air-to-water heat pump: (yes/no)				no			
Brine-to-water heat pump: (yes/no)				yes			
Water-to-water heat pump: (yes/no)				no			
Low-temperature heat pump: (yes/no)				no			
Equipped with supplementary heater: (yes/no)				yes			
combination heater with: (yes/no)				no			
application: (low/medium)				medium			
climate: (colder/average/warmer)				average			
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output	Prated	35	kW	Seasonal space heating energy efficiency	η_S	137,2	%
Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj			
Tj = -7°C	Pdh	35,1	kW	Tj = -7°C	COPd	3,06	-
Tj = +2°C	Pdh	35,9	kW	Tj = +2°C	COPd	3,58	-
Tj = +7°C	Pdh	36,4	kW	Tj = +7°C	COPd	3,98	-
Tj = +12°C	Pdh	36,9	kW	Tj = +12°C	COPd	4,44	-
Tj = bivalent temperature	Pdh	34,8	kW	Tj = bivalent temperature	COPd	2,94	-
Tj = operation limit temperature	Pdh	34,8	kW	Tj = operation limit temperature	COPd	2,94	-
For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	Pdh	-	kW	For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	COPd	-	-
Bivalent temperature	T _{biv}	-10	°C	For air-to-water heat pumps: Operation limit temperature	TOL	-10	°C
Cycling interval capacity for heating	P _{cyh}	-	kW	Cycling interval efficiency	COP _{cyh}	-	-
Degradation co-efficient (**)	Cdh	1,0	-	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P _{OFF}	0,015	kW	Rated heat output	P _{sup}	-	kW
Thermostat-off mode	P _{TO}	0,015	kW	Type of energy input	electrical		
Standby mode	P _{SB}	0,015	kW				
Crankcase heater mode	P _{CK}	-	kW				
Other items							
Capacity control	fixed			For air-to-water heat pumps: Rated air flow rate, outdoors	-	-	m ³ /h
sound power level, indoors/outdoors	L _{WA}	54 / -	dB	For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-	13	m ³ /h
Emissions of nitrogen oxides	NO _x	-	mg/kWh				
For heat pump combination heater:							
Declared load profile	-			Water heating energy efficiency	η_{wh}	-	%
Daily electricity consumption	Q _{elec}	-	kWh	Daily fuel consumption	Q _{fuel}	-	kWh
Contact details	ait deutschland GmbH Industriestr. 3 95359 Kasendorf Germany						
(*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).							
(**) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.							

Model				SIP 37.1			
Air-to-water heat pump: (yes/no)				no			
Brine-to-water heat pump: (yes/no)				yes			
Water-to-water heat pump: (yes/no)				no			
Low-temperature heat pump: (yes/no)				no			
Equipped with supplementary heater: (yes/no)				yes			
combination heater with: (yes/no)				no			
application: (low/medium)				low			
climate: (colder/average/warmer)				average			
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output	Prated	37	kW	Seasonal space heating energy efficiency	η_S	201,4	%
Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature Tj			
Tj = -7°C	Pdh	37,2	kW	Tj = -7°C	COPd	4,85	-
Tj = +2°C	Pdh	37,5	kW	Tj = +2°C	COPd	5,19	-
Tj = +7°C	Pdh	37,7	kW	Tj = +7°C	COPd	5,52	-
Tj = +12°C	Pdh	38,0	kW	Tj = +12°C	COPd	5,86	-
Tj = bivalent temperature	Pdh	37,2	kW	Tj = bivalent temperature	COPd	4,79	-
Tj = operation limit temperature	Pdh	37,2	kW	Tj = operation limit temperature	COPd	4,79	-
For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	Pdh	-	kW	For air-to-water heat pumps: Tj = -15°C (if TOL < -20°C)	COPd	-	-
Bivalent temperature	T _{biv}	-10	°C	For air-to-water heat pumps: Operation limit temperature	TOL	-10	°C
Cycling interval capacity for heating	P _{cyh}	-	kW	Cycling interval efficiency	COP _{cyh}	-	-
Degradation co-efficient (**)	Cdh	1,0	-	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P _{OFF}	0,015	kW	Rated heat output	P _{sup}	-	kW
Thermostat-off mode	P _{TO}	0,015	kW	Type of energy input	electrical		
Standby mode	P _{SB}	0,015	kW				
Crankcase heater mode	P _{CK}	-	kW				
Other items							
Capacity control	fixed			For air-to-water heat pumps: Rated air flow rate, outdoors	-	-	m ³ /h
sound power level, indoors/outdoors	L _{WA}	54 / -	dB	For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-	13	m ³ /h
Emissions of nitrogen oxides	NO _x	-	mg/kWh				
For heat pump combination heater:							
Declared load profile	-			Water heating energy efficiency	η_{wh}	-	%
Daily electricity consumption	Q _{elec}	-	kWh	Daily fuel consumption	Q _{fuel}	-	kWh
Contact details	ait deutschland GmbH Industriestr. 3 95359 Kasendorf Germany						
(*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).							
(**) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.							